


Patient: Barry Hills
Recorded: Tuesday, July 1, 2025 at 6:33:09 AM
Heart Rate: 52 BPM
Duration: 30s

Kardia Determination: Possible Atrial Fibrillation
*Kardia Determination is done on Lead I.


Enhanced Filter, Mains Frequency: 60Hz Scale: 25mm/s, 10mm/mV

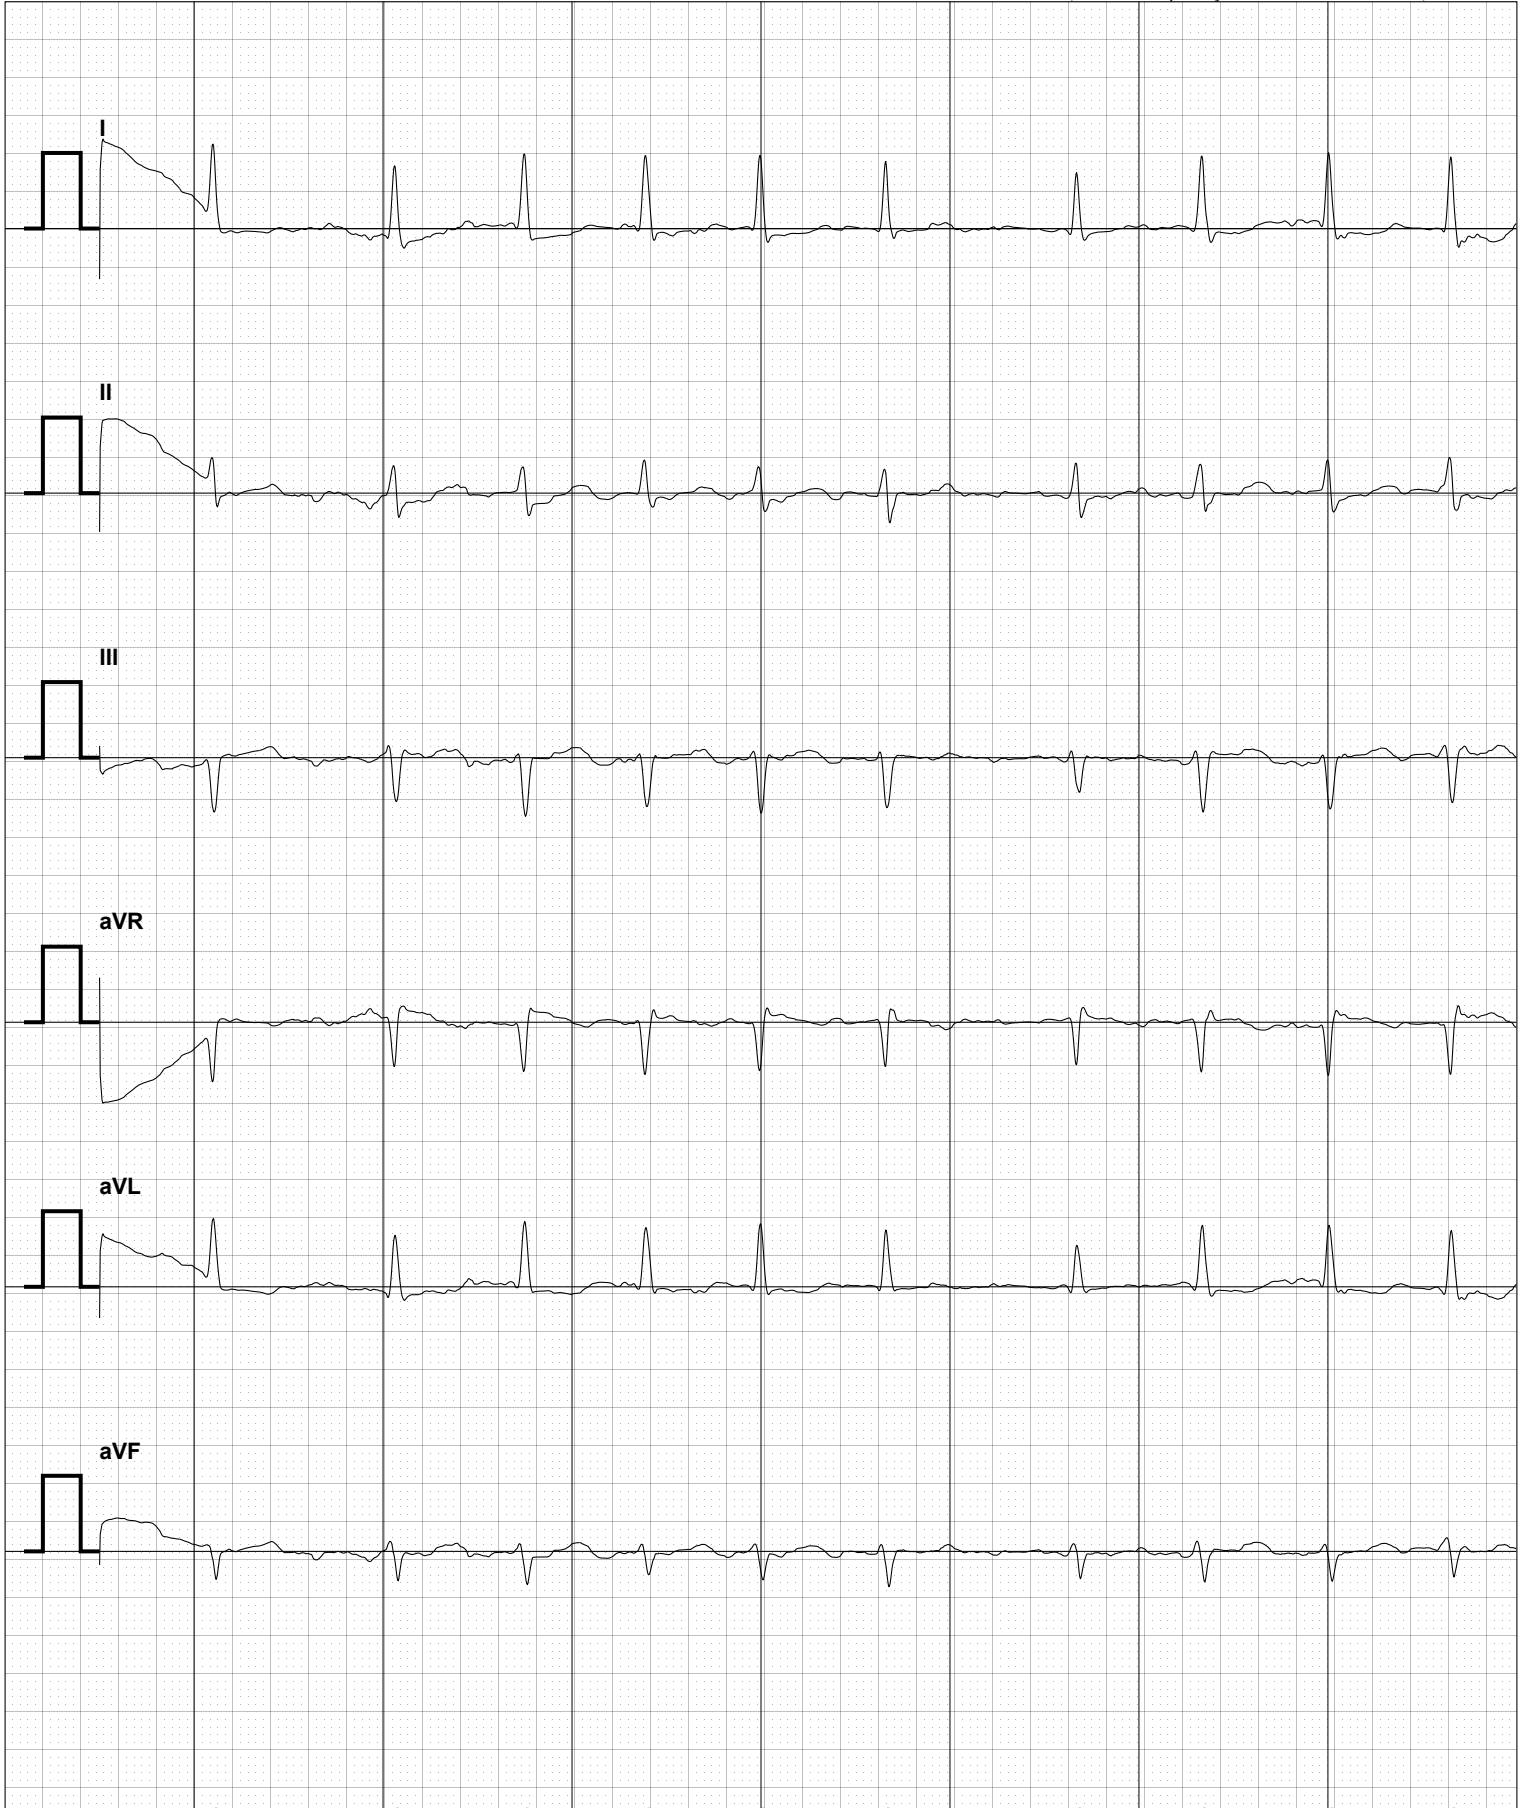

Patient: Barry Hills
Recorded: Tuesday, July 1, 2025 at 6:33:09 AM
Heart Rate: 52 BPM
Duration: 30s

Kardia Determination: Possible Atrial Fibrillation
*Kardia Determination is done on Lead I.


Enhanced Filter, Mains Frequency: 60Hz Scale: 25mm/s, 10mm/mV

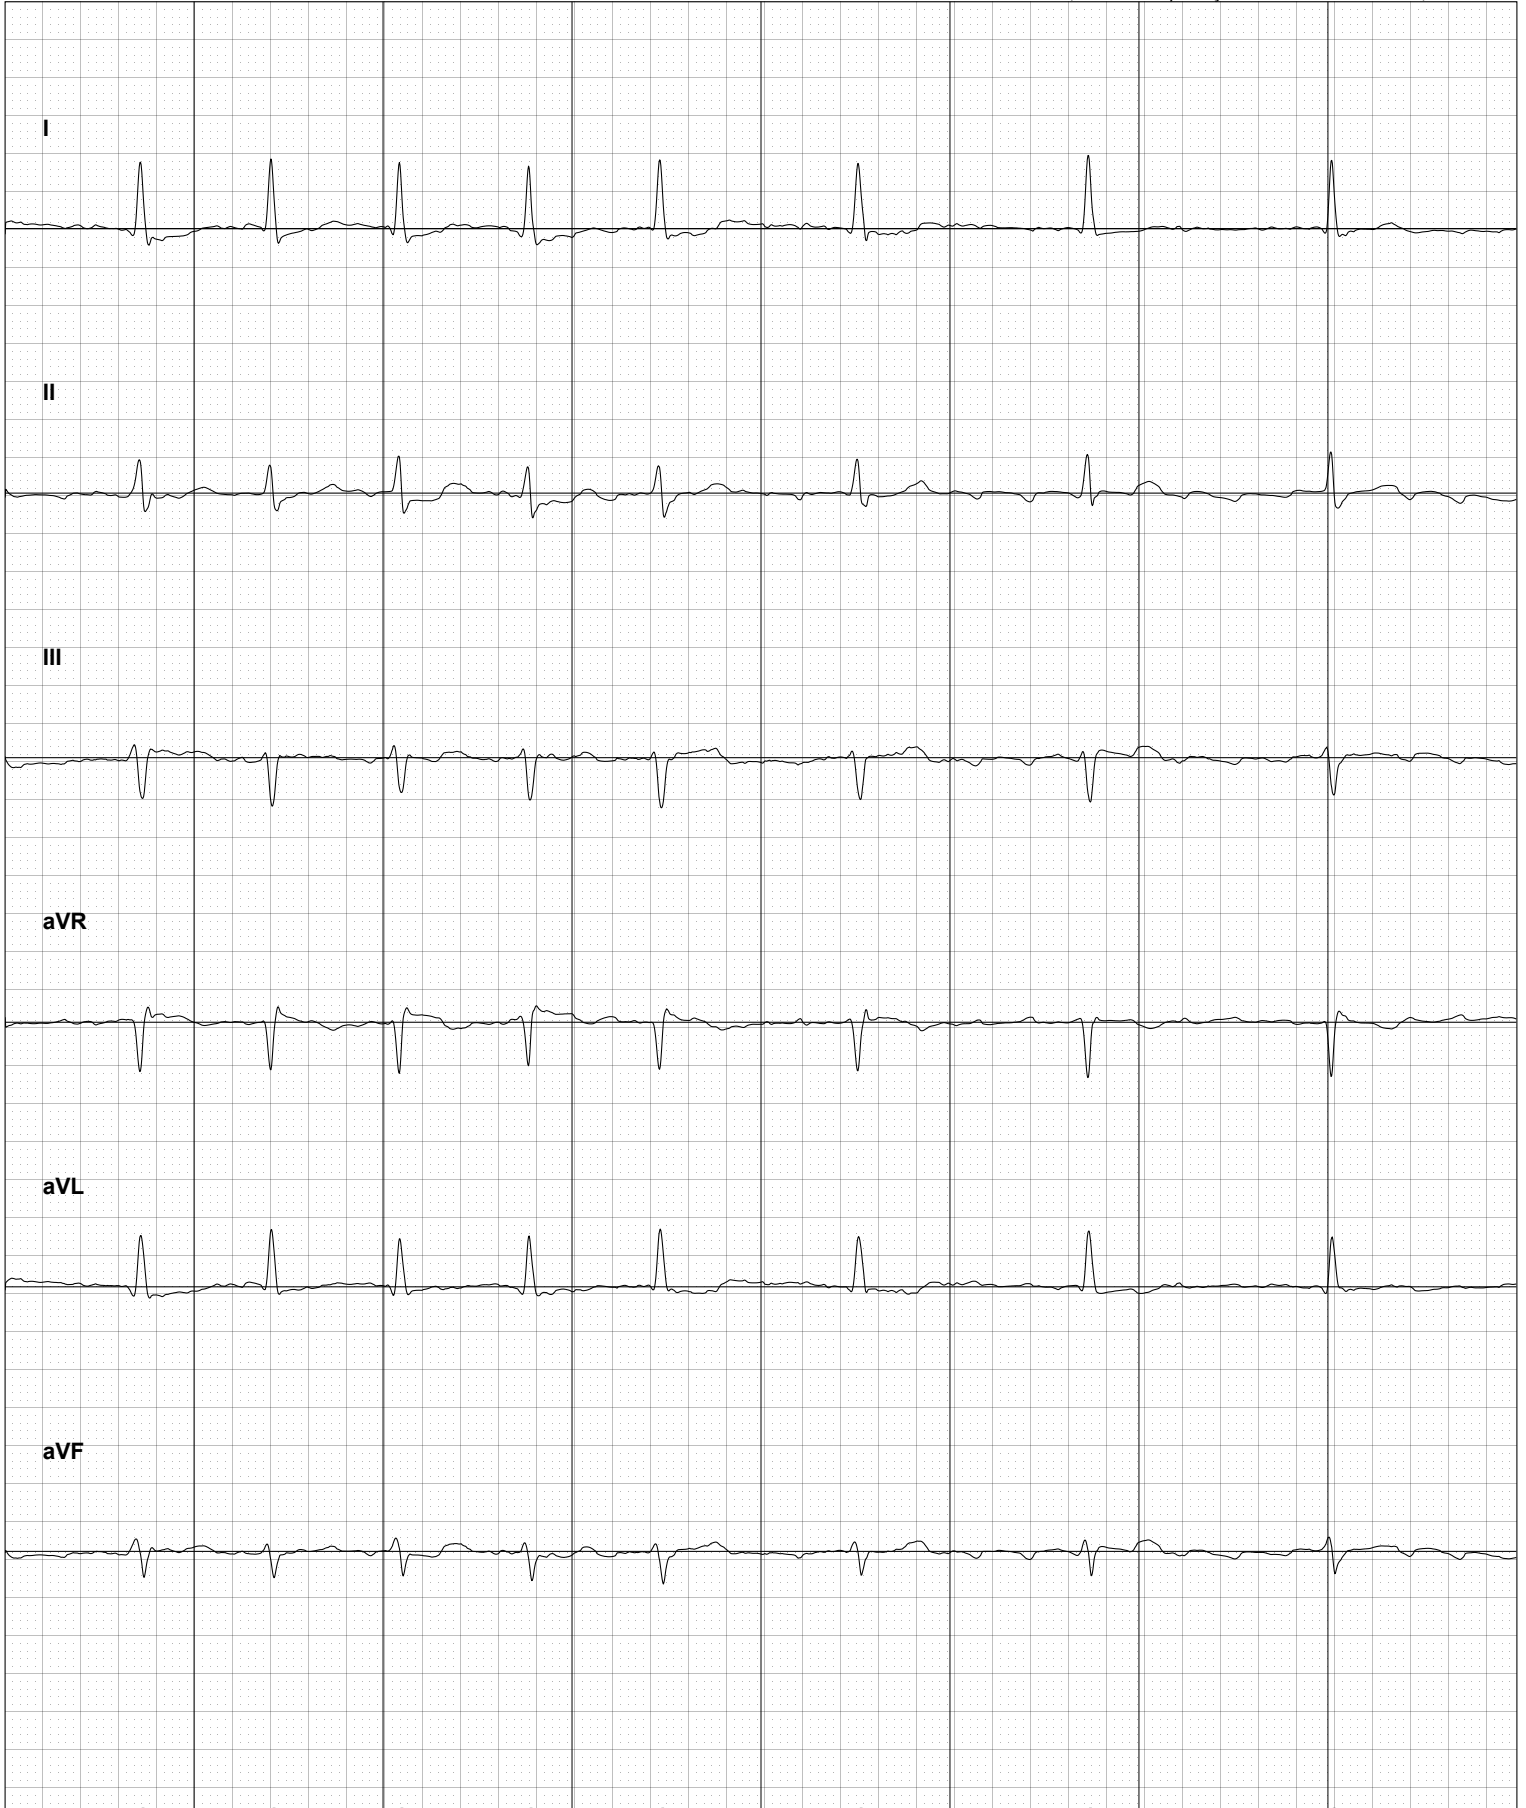

Patient: Barry Hills
Recorded: Tuesday, July 1, 2025 at 6:33:09 AM
Heart Rate: 52 BPM
Duration: 30s

Kardia Determination: Possible Atrial Fibrillation
*Kardia Determination is done on Lead I.

Enhanced Filter, Mains Frequency: 60Hz Scale: 25mm/s, 10mm/mV

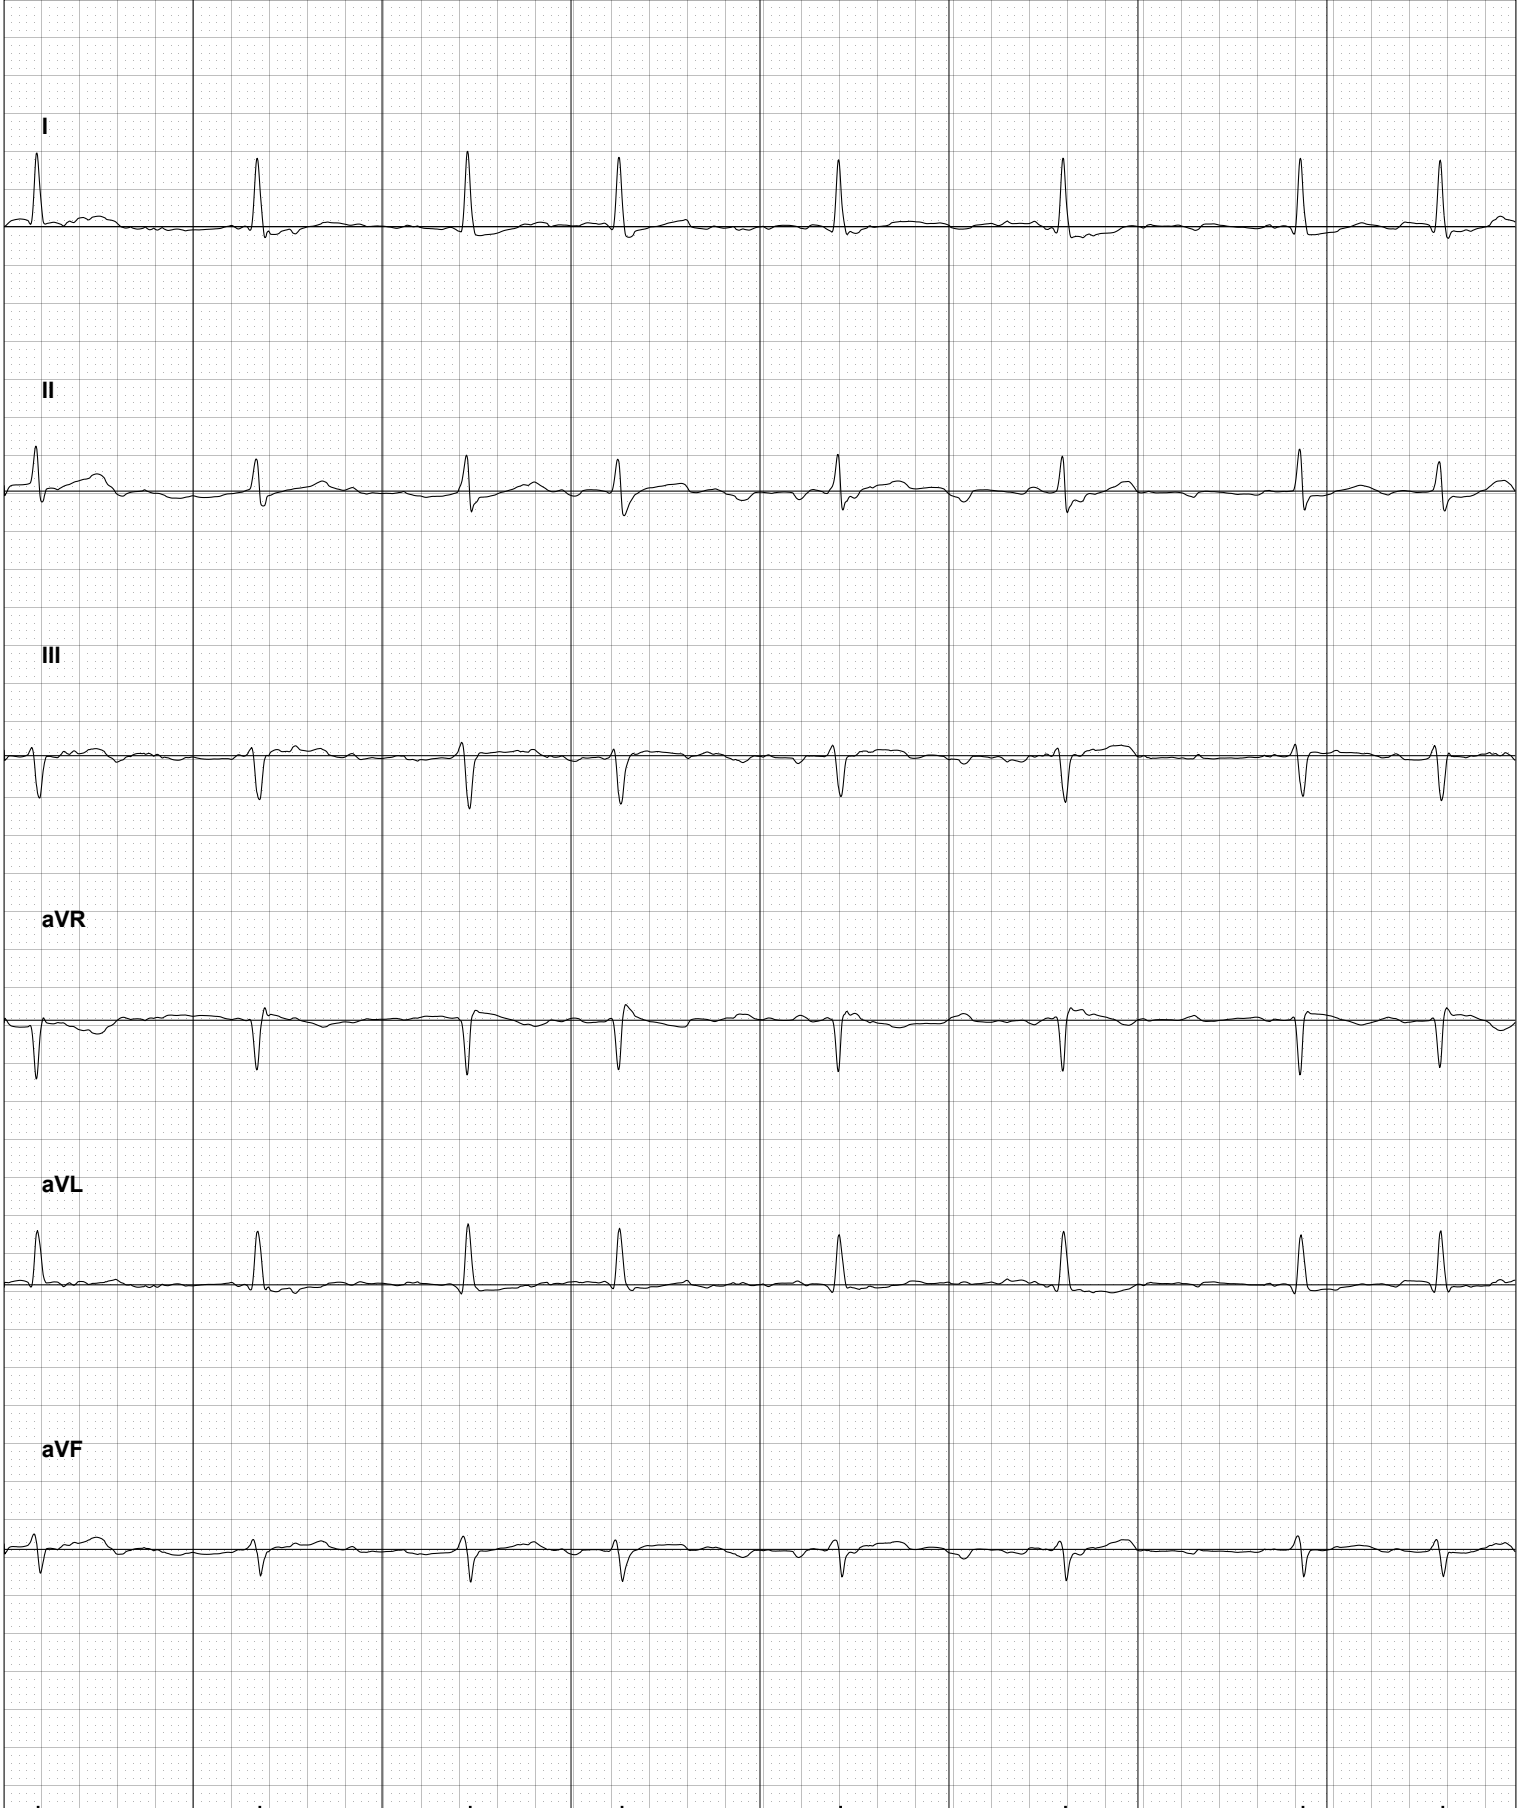

Patient: Barry Hills
Recorded: Tuesday, July 1, 2025 at 6:33:09 AM
Heart Rate: 52 BPM
Duration: 30s

Kardia Determination: Possible Atrial Fibrillation
*Kardia Determination is done on Lead I.

Enhanced Filter, Mains Frequency: 60Hz Scale: 25mm/s, 10mm/mV

