Kardia

Patient: Barry Hills
Recorded: Friday, August 22, 2025 at 7:04:26 AM
Heart Rate: 92 BPM
Duration: 30s

Kardia Determination: Possible Atrial Fibrillation

Enhanced Filter, Mains Frequency: 60Hz Scale: 25mm/s, 10mm/mV

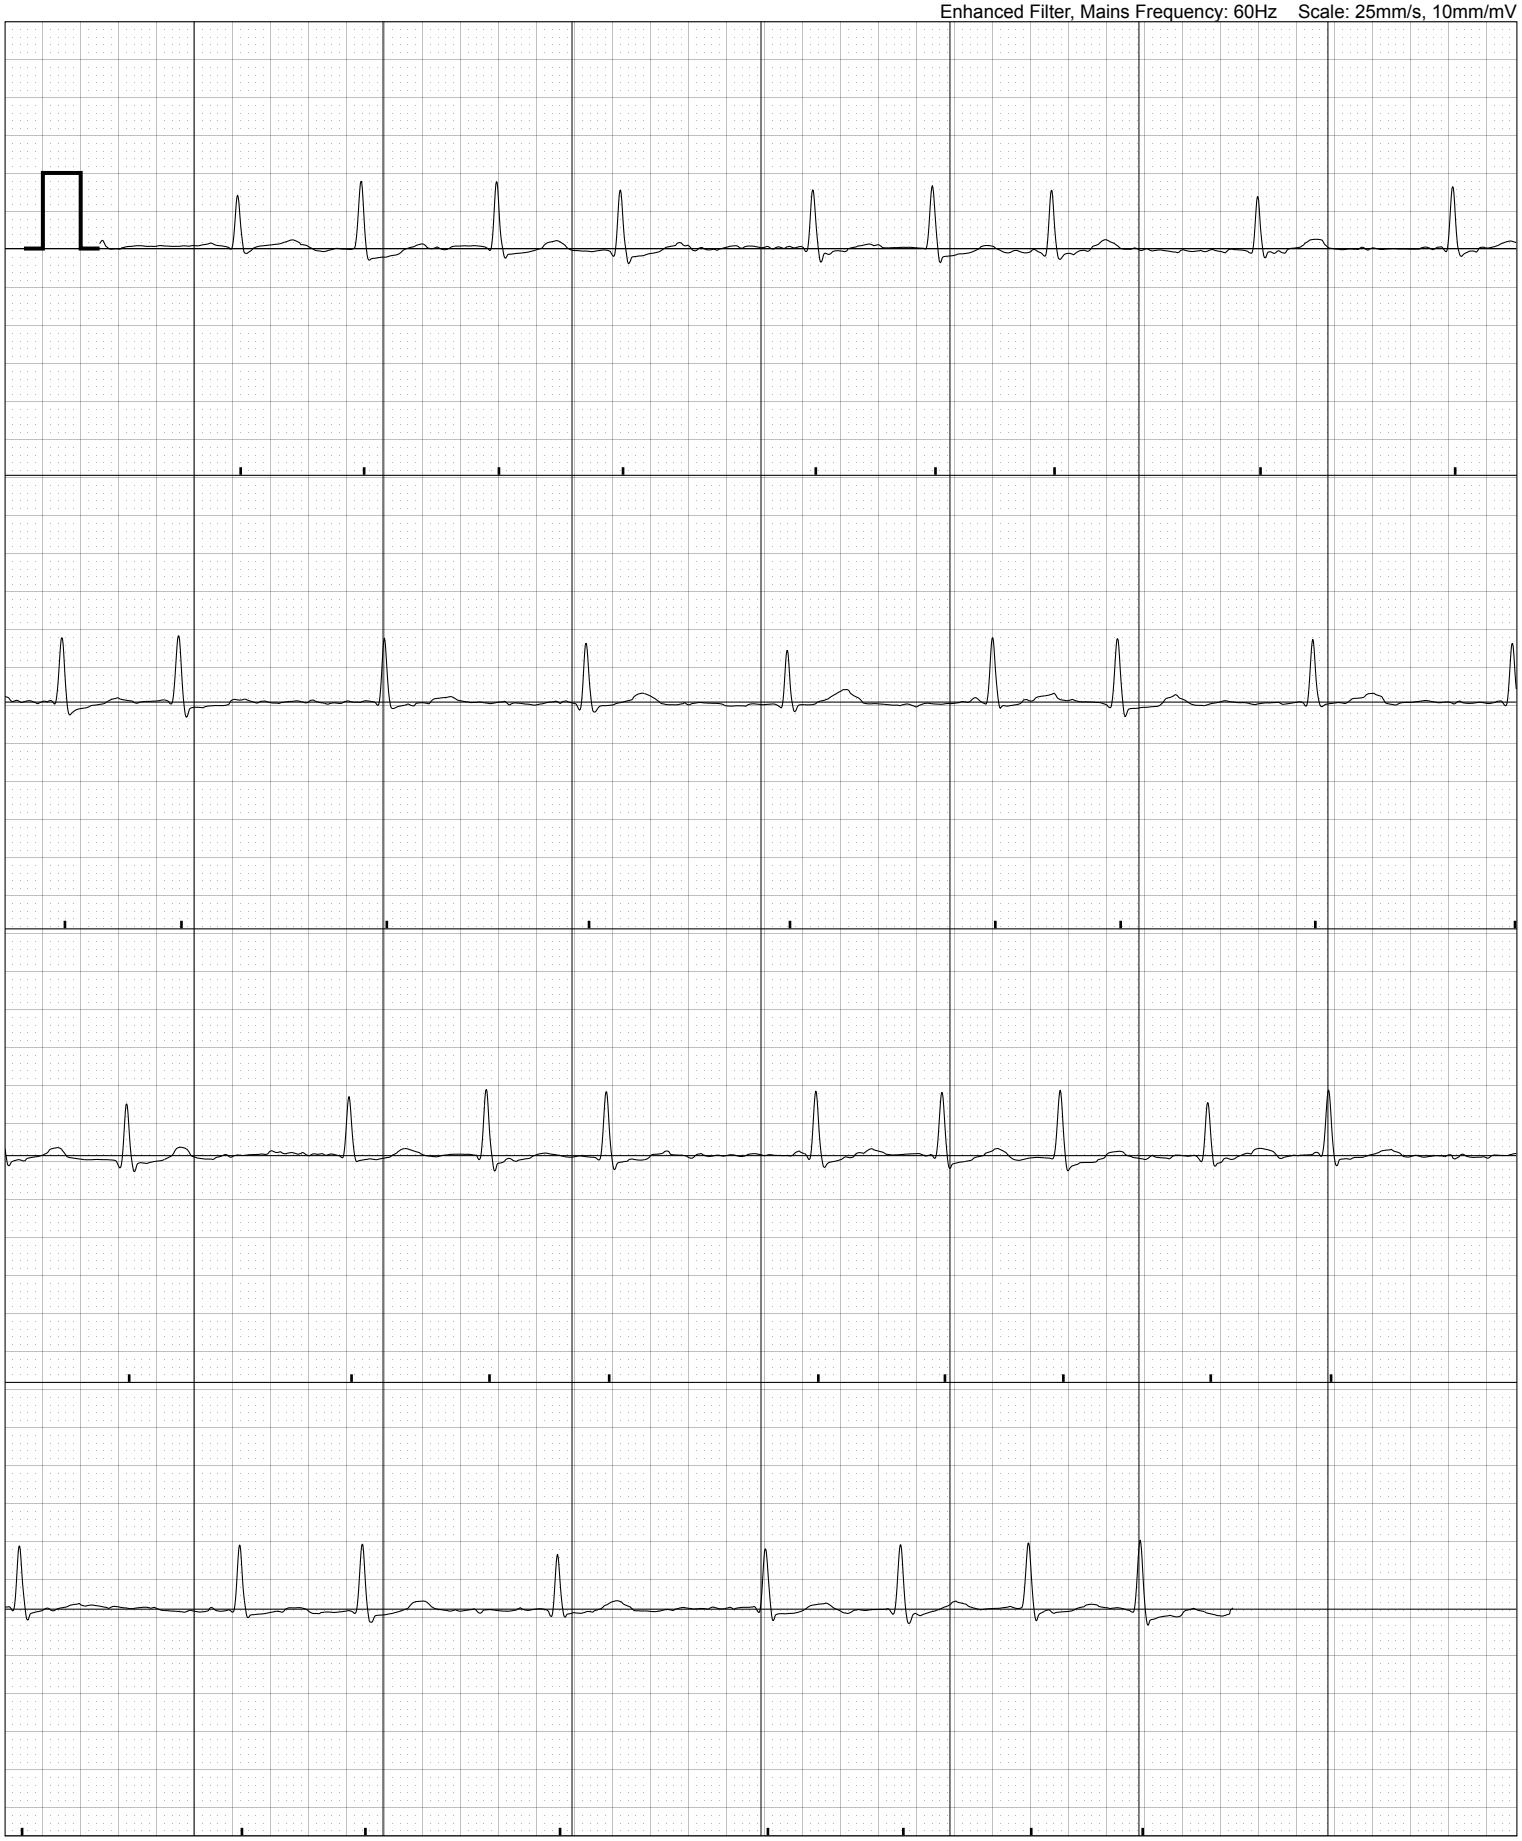

(c) Copyright 2022, AliveCor Inc.